

SHARP

DUCTLESS BI-BLOCK
WALL UNIT



ECOLOGICALLY RESPONSIBLE
WITH UNRIVALED PERFORMANCE

CPU SERIES
12 000 BTU/H



World's First Mini-Split
with Built-in MERV 14 Filters



Refrigerant R32 | Environmentally friendly



WWW.SHARPHVAC.CA

*Plasmacluster is a registered trademark
or trademark of SHARP Corporation.

Models Number	AY-XP12CPU AHR: 216624517	
Air conditioning Capacity (Btu/h)	12 500	
Air conditioning Capacity Min - Max (Btu/h)	2 800 - 13 600	
Heating Capacity (Btu/h)	14 000	
Heating Capacity Min - Max (Btu/h)	3 200 - 17 000	
Maximum heating @ -8,3 °C (17 °F) (Btu/h) (COP)	15 000 (2.31)	
Maximum heating @ -15 °C (5 °F) (Btu/h) (COP)	12 500 (2.1)	
Maximum heating @ -20 °C (-4 °F) (Btu/h) (COP)	10 800 (2.0)	
Maximum heating @ -25 °C (-13 °F) (Btu/h) (COP)	9 000 (1.82)	
Maximum heating @ -30 °C (-22 °F) (Btu/h) (COP)	8 400 (1.86)	
EER ²	12.1	
SEER ²	21.0	
HSPF ² (IV) 10.5 / HSPF ² (V) 8.5	11.0 / 10.0	
V, Hz, Phase	208-230/60/1	
Maximum Fuse Size (A)	15	
Dehumidification Pt/h	1.9	
Air conditioning: Sound level (dB)	49 / 43 / 37 / 28 / 24	
Air conditioning: Sound level (dB unite ext.)	49	
Heating: Sound level (dB)	49 / 43 / 37 / 29 / 24	
Heating: Sound level (dB unite ext.)	50	
Air cond.: Air flow (ft³/min Sh/H/M/B/Sb)	388 / 367 / 282 / 226 / 106	
Heating: Air flow (ft³/min Sh/H/M/B/Sb)	388 / 367 / 282 / 226 / 106	
Operating range of exterior temperature: Air cond.	14 à 115°F (-10 à 46°C)	
Operating range of exterior temperature: Heating	-17 à 75°F (-27 à 24°C)	
Pipe Diameter (Liq x Gas) (in.)	1/4 x 3/8	
Refrigerant	R32	
Combined Max. length ft. (m)	66 (20) (pré-charge: 25')	
Max. height ft. (m)	33 (10)	
Pipe Diameter (in.)	Gas 3/8	Liquid 1/4
Total weight lb (kg)	38 (17)	67 (30)
Dimensions: Width in.	31-27/64	36-5/16
Dimensions: Height in.	11	23-3/4
Dimensions: Depth in.	20-9/32	15-15 / 32
SHARP		
	AY-XP12CPU INDOOR	AE-X120PU OUTDOOR



Technologie Plasmacluster

SHARP'S unique bacteria-removing Plasmacluster Technology suppresses airborne viruses, and breaks down and removes airborne mold and other contaminants.

Plasmacluster Key Benefits

- Suppresses the activity of airborne viruses
- Suppresses the activity of airborne microbes
- Acts on both airborne and adhering mold
- Inactivates and removes airborne allergens like dust mite feces and dead dust mites
- Inactivates and removes adhering odours (like tobacco smoke)
- Removes static electricity which attracts airborne particles
- Plasmacluster is effective all year round




Plasmacluster's Microbe-Removing Mechanisms

1 Ions are released.


Plasmacluster Ions, the same positive and negative ions found in nature, are generated by plasma discharge and released into the air.

The ions are long-lasting*3 because they are surrounded by water molecules.




2 The ions act on airborne microbes.

The ions form hydroxide (OH) radicals that are highly oxidizing only when they adhere to the surfaces of mold and viruses. They instantly remove the hydrogen from the surface proteins, breaking them down.



3 The broken-down components return to the air as water.

The hydroxide (OH) radicals combine with hydrogen (H) to form water (H2O), which returns to the air.



Integrated SHARP Wi-Fi on all your units for greater control and convenience.



COANDA EFFECT UP TO 50 FEET
NEVER HAVE AIR DIRECTLY ON YOU AGAIN






SHARP "HOT GAS PIPE" system ensures that all condensation holes are kept clear without affecting energy efficiency.



« HOT GAS PIPE »
Unique to SHARP



AN INNOVATIVE CHANGE IN THE FIELD. SHARP STILL A WORLD LEADER!

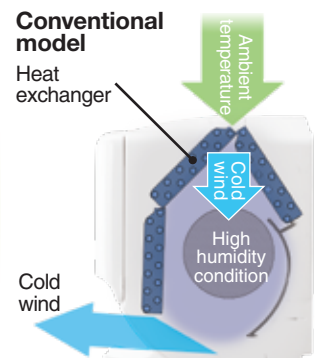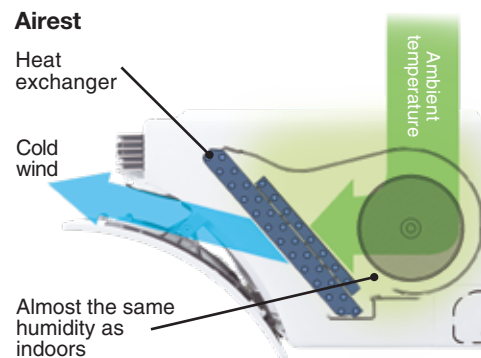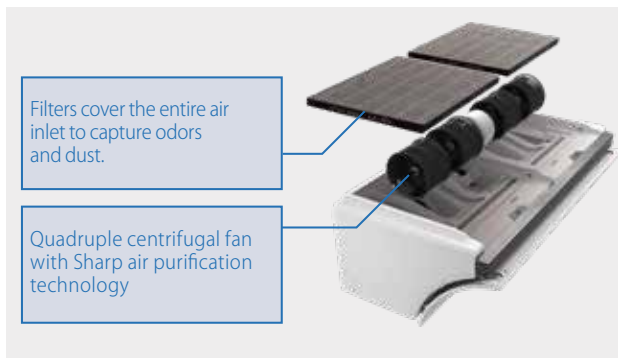

SHARP

• Plasmacluster cannot create a completely sterile environment, or ensure prevention of infection. • The actual number of ions and effectiveness of microbe removing*1 and purifying*2 depend on the room conditions and the operation methods, including room size or shape, whether air conditioning or ventilation is used, product placement, direction of ion discharge, and operation mode. *1 Airborne viruses are suspended in a 1m3 box, and the percentages of the viruses removed after 10 minutes are measured. Suspended microbes subjected to Plasmacluster air purification are measured after 38 minutes in a testing room of about 40 m3. Test results may differ results in actual room conditions. *2 The effectiveness depends on the surrounding conditions (e.g., temperature, humidity and airflow), usage time and method. *3 Verified in SHARP test comparisons of ions not surrounded by water molecules.

